


C:\Clients\61610701_Wallowa MOB Addition\Mech\9701_M200.dwg, M221, 2/6/2019 4:28:16 PM, ARCT full based E1 (30.00 x 42.00 inches), 1:1

CLARK K JOS ARCHITECTS, LLC COPYRIGHT 2018

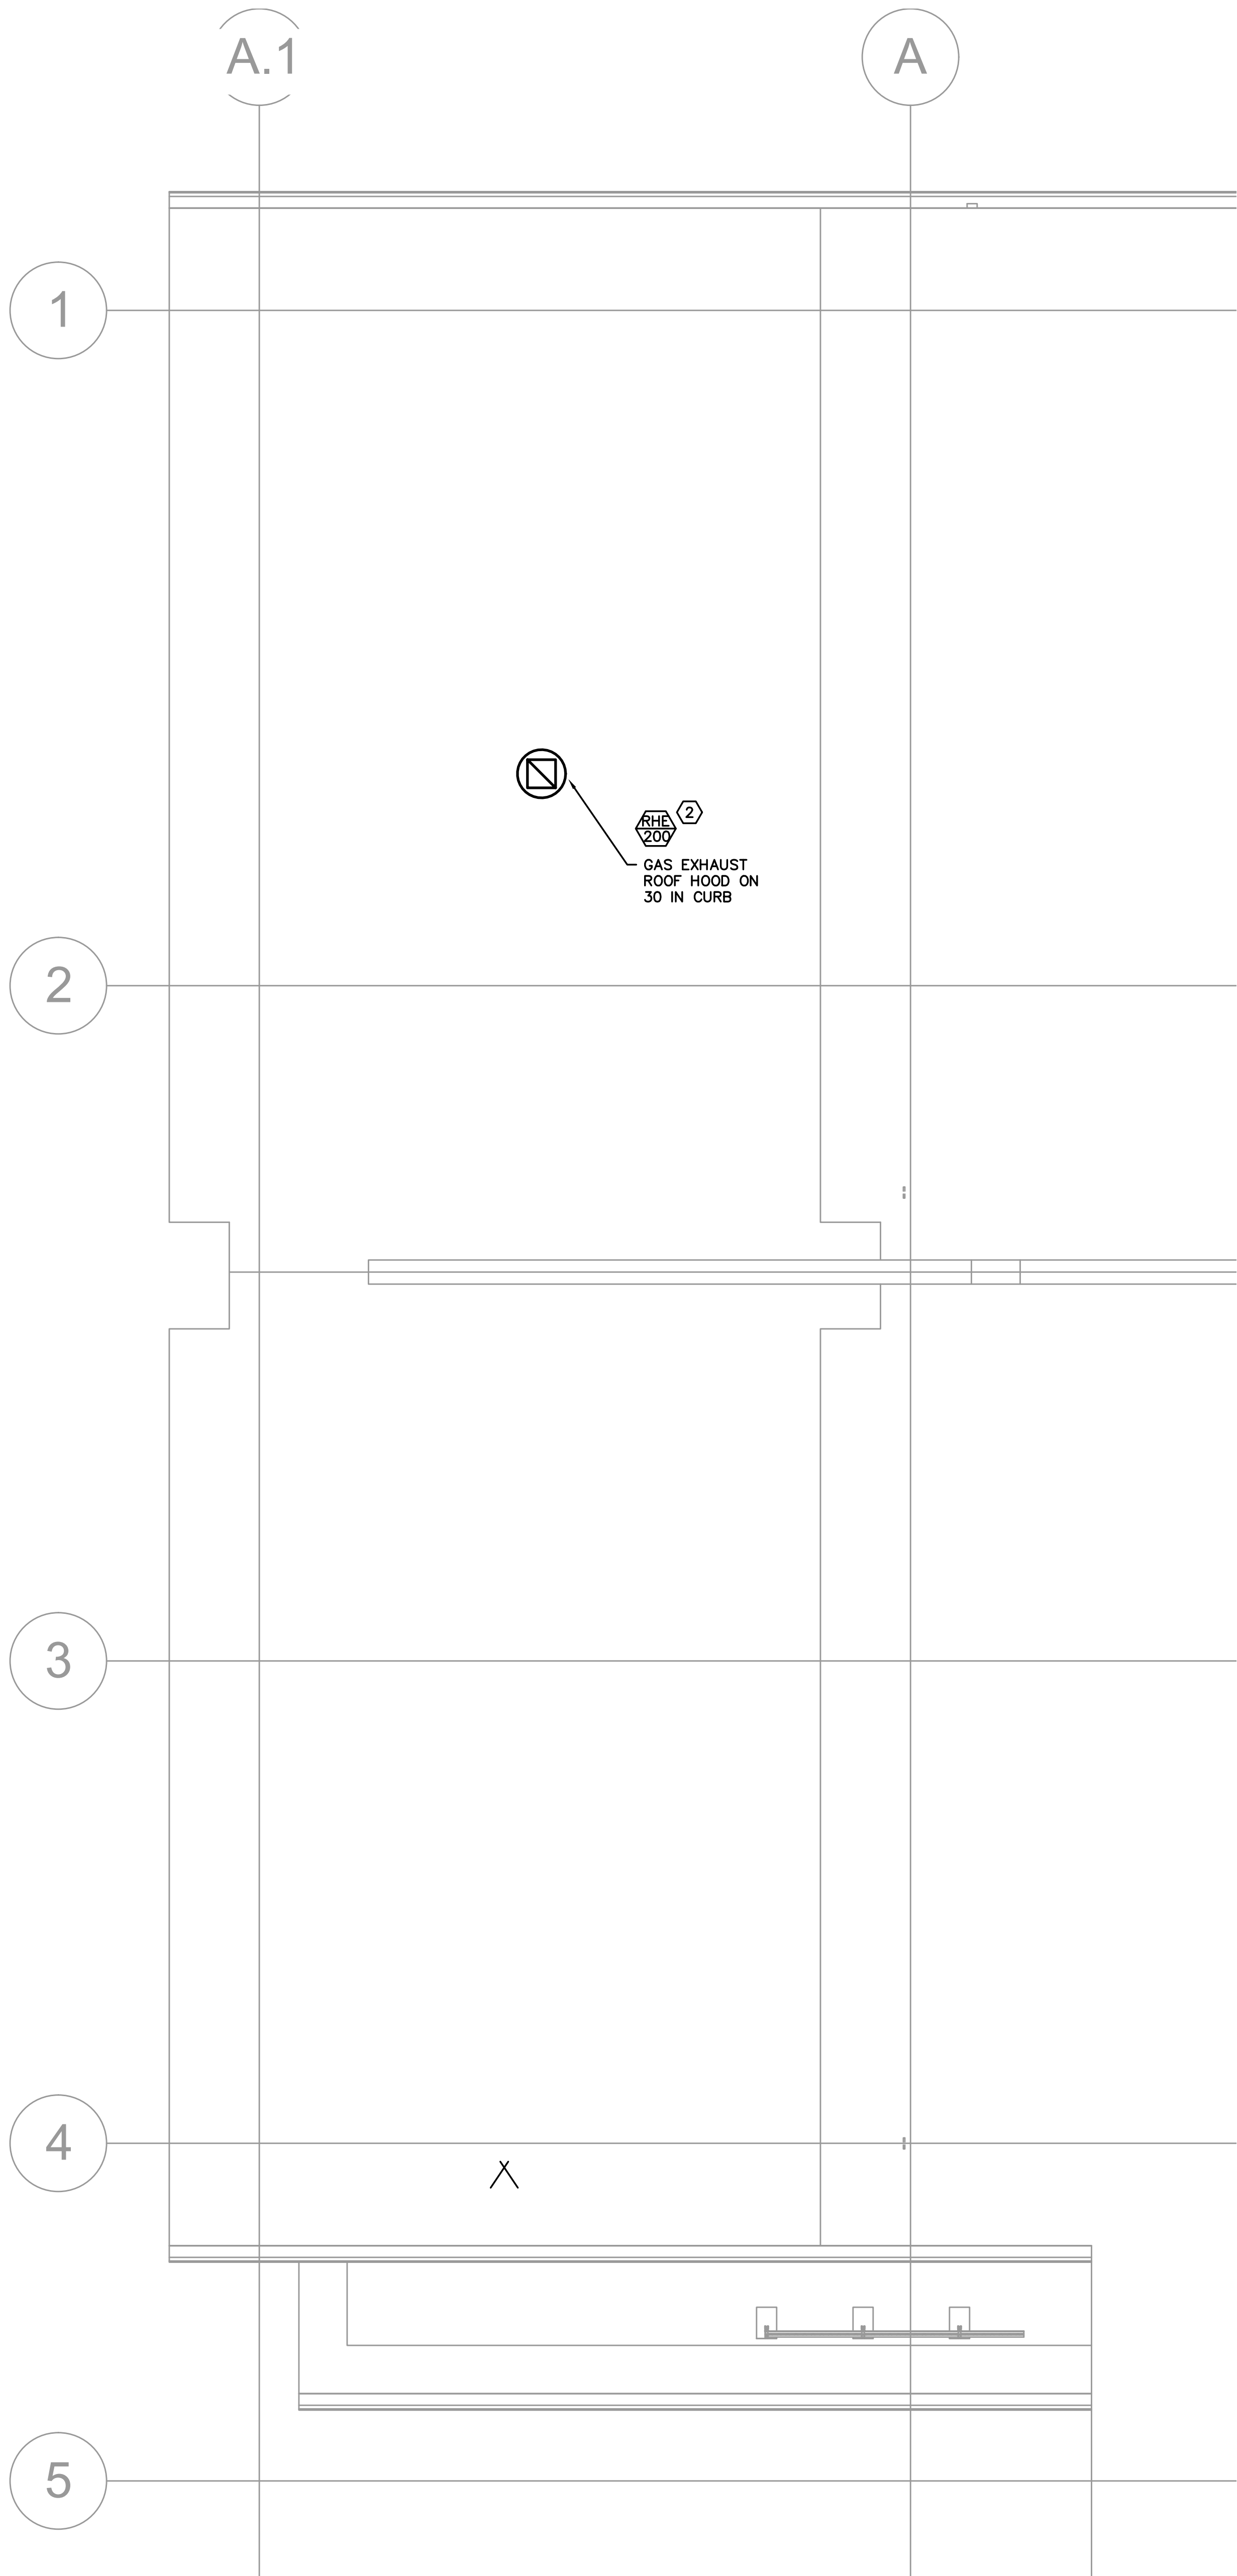

1
M221


HVAC NEW WORK ROOF PLAN
SCALE: 1/4" = 1'-0"

GENERAL NOTES:

- A. VERIFY ALL EXISTING CONDITIONS RELATIVE TO THE SCOPE OF WORK. DO NOT FABRICATE PIPING W/O CONFIRMING SPACE EXISTS, FOR SIZES REQUIRED.
- B. COORDINATE ALL MECHANICAL AND CONTROL WORK WITH GENERAL CONTRACTOR, CONTROL CONTRACTOR, ELECTRICAL AND ARCHITECTURAL.

⊗ MECHANICAL KEYED NOTES:

1. VRF CONDENSING UNIT IN MECHANICAL ROOM. PROVIDE VIBRATION ISOLATION AND INSTALL ON HOUSEKEEPING PAD PER MANUFACTURERS INSTALLATION REQUIREMENTS. PROVIDED FLEXIBLE CONNECTOR AND DUCTED PLENUM TO OUTDOOR AIR LOUVER.
2. GAS STORAGE ROOM EXHAUST ROOF-HOOD. INSTALL ON HIGH ROOF CURB SO DISCHARGE IS 36 IN ABOVE ROOF SURFACE.

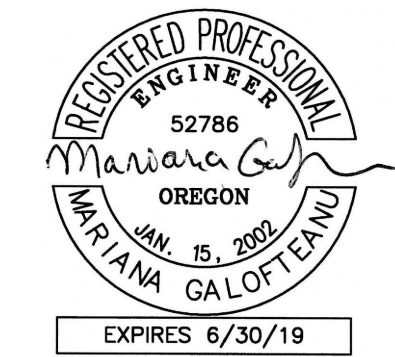



Wallowa MOB Addition

Wallowa County Healthcare District

603 Medical Pkwy, Enterprise, OR 97628

ISSUE DATE:	02.12.2019
REVISIONS:	
1 MISC REV.	02.11.2019

HVAC ROOF PLAN

MFI Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0877
E-MAIL: WWW.MFI-ENG.COM
CONTACT: Mariana Galofteanu

M2.21

CLARK K JOS
ARCHITECTS, LLC

621 SW Alder Street, Suite 700
Portland, OR 97205
Phone: 503.224.4848

Bid / Permit Set